

TASSELLO CON CHiodO ACCIAIO

NEW!



ETAG 014

ABC


quick
drill **25mm**

**strong
plus**



**thermal
pro**

Thermal conductivity of
ONLY 0.002 [W/K]!!

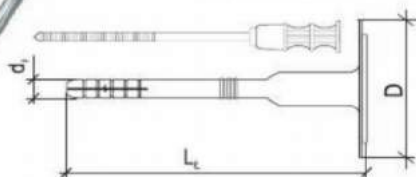


ARTICOLO	Ø x Lt	Spessore isolamento	pezzi per scatola
4095W	8 x 95	60/80	200
4115W	8 x 115	80/100	200
4135W	8 x 135	100/120	200
4155W	8 x 155	120/140	200
4175W	8 x 175	140/160	200
4195W	8 x 195	160/180	200
4215W	8 x 215	180/200	100
4235W	8 x 235	200/220	100
4255W	8 x 255	220/240	100
4275W	8 x 275	240/260	100
4295W	8 x 295	260/280	100

Dati tecnici

Ø del foro	8mm
profondità di ancoraggio	25mm
profondità del foro	35mm
Ø della rondella	60mm
rigidità della rondella	0,06(kN/mm)
Norma Tecnica	ETA 11/0232
Materiale tassello	PE
Materiale Chiodo	acciaio+nylon

PRESTAZIONI								
Categoria	A		B		C			
Materiali di supporto	Calcestruzzo C12/15	Calcestruzzo C16/20-C50/60	Mattone pieno MZ	Mattone pieno silico-calcareo - KS	Mattone forato silico-calcareo - KSL	Mattone a fori verticali - HLZ	Porotherm 25	Mega-Max
N _{Rk} [kN]	1,2	1,5	1,5	1,5	1,2	0,6	0,6	0,6
Interasse minimo s _{min} =100mm Distanza minima dai bordi c _{min} =100mm								
N[kN] δ [mm]	0,4/0,8	0,5/0,85	0,4/1,0	0,5/0,98	0,4/0,9	0,2/0,61	0,2/0,46	0,2/0,61
Diametro testa: 60mm					Spessore materiale isolante: 60-320mm			
Resistenza placca: 4,3kN					Trasmittanza termica puntuale: 0,002W/K			
Rigidità placca: 0,6kN/mm								
N _{Rk} – resistenza caratteristica; N – carico assiale; δ – scostamento								

Metodo di installazione

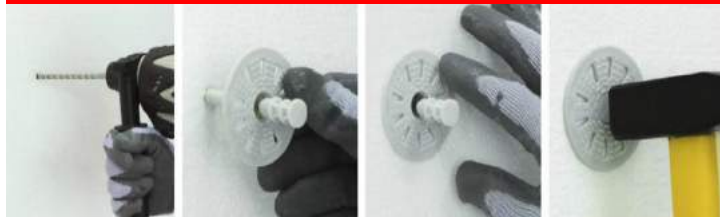

INSULATION TYPE

POLYSTYRENE FOAM

EXTRUDED POLYSTYRENE

MINERAL WOOL

MINERAL WOOL LAMELLA

* with support washer TDX-140 / TDX-90





INSTYTUT TECHNIKI BUDOWLANEJ
PL 00-611 WARSZAWA
ul. Filtrowa 1
tel.: (+48 22) 825-04-71
(+48 22) 825-76-55
fax: (+48 22) 825-52-86
www.itb.pl



Member of



www.eota.eu

European Technical Assessment

**ETA-11/0232
of 08/09/2016**

General Part

Technical Assessment Body issuing the European Technical Assessment

Instytut Techniki Budowlanej

Trade name of the construction product

WK THERM ϕ 8 BILDEX 4095W_4295W

Product family to which the construction product belongs

Nailed-in plastic anchors for fixing of external thermal insulation composite systems with rendering in concrete and masonry

Manufacturer

KLIMAS Sp. z o. o
ul. Wincentego Witosa 135/137
Kućnica Kiedrzyńska
PL 42-233 Mykanów
Poland

Manufacturing plant

KLIMAS Sp. z o. o
ul. Warszawska 2
Wanaty
PL 42-260 Kamienica Polska
Poland

This European Technical Assessment contains

17 pages including 3 Annexes which form an integral part of this Assessment

This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of

Guideline for European technical approval of "Plastic anchors for fixing of external thermal insulation composite systems with rendering", ETAG 014, edition February 2011, used as European Assessment Document (EAD) according to Article 66 Paragraph 3 of Regulation (EU) No 305/2011.

This version replaces

ETA-11/0232 issued on 07/09/2011

This European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

Specific Part

1 Technical description of the product

The WKTHERM ϕ 8 nailed-in plastic anchor consists of an anchor sleeve with a plate made of polyethylene and an accompanying specific nail as an expansion pin made of the galvanised steel with a head covered by polyamide as a plastic coat.

The WKTHERM ϕ 8 anchor may in addition be combined with anchor plate TDX-90, TDX-P-90, TDX-140 or TDX-P-140.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document (EAD)

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed working life of the anchor of 25 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer or Technical Assessment Body, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Performance of the product

3.1.1 Mechanical resistance and stability (BWR 1)

Requirements with respect to the mechanical resistance and stability of non load bearing parts of the works are not included in this Basic Works Requirements but are under the Basic Works Requirement safety in use (BWR 4).

3.1.2 Hygiene, health and the environment (BWR 3)

Regarding dangerous substances, there may be requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Regulation (EU) No 305/2011, these requirements need also to be complied with, when and where they apply.

3.1.3 Safety and accessibility in use (BWR 4)

Essential characteristic	Performance
Characteristic resistance	Annex C1
Edge distances and spacings	Annex B2
Point thermal transmittance	Annex C2
Plate stiffness	Annex C2
Displacements	Annex C3

3.1.4 Sustainable use of natural resources (BWR 7)

No performance assessed.

3.2 Methods used for the assessment

The assessment of the anchor for the declared intended use in relation to the requirements for mechanical resistance and stability and safety in use in the sense of the Basic Requirement 4 has been made in accordance with the ETAG 014 "Plastic anchors for fixing of external thermal insulation composite systems with rendering", Edition February 2011.

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

According to the Decision 97/463/EC of the European Commission the system of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table applies.


Product	Intended use	Level or class	System
Plastic anchor for use in concrete and masonry	For use in systems, such as facade systems, for fixing or supporting elements which contribute to the stability of the systems	-	2+

5 Technical details necessary for the implementation of the AVCP system, as provided in the applicable European Assessment Document (EAD)


Technical details necessary for the implementation of the AVCP system are laid down in the control plan which is deposited at Instytut Techniki Budowlanej.

For type testing the results of the tests performed as part of the assessment for the European Technical Assessment shall be used unless there are changes in the production line or plant. In such cases the necessary type testing has to be agreed between Instytut Techniki Budowlanej and the notified body.

Issued in Warsaw on 08/09/2016 by Instytut Techniki Budowlanej

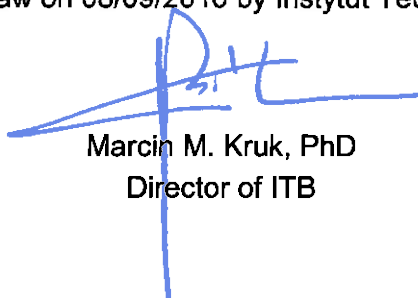

Marcin M. Kruk, PhD
Director of ITB


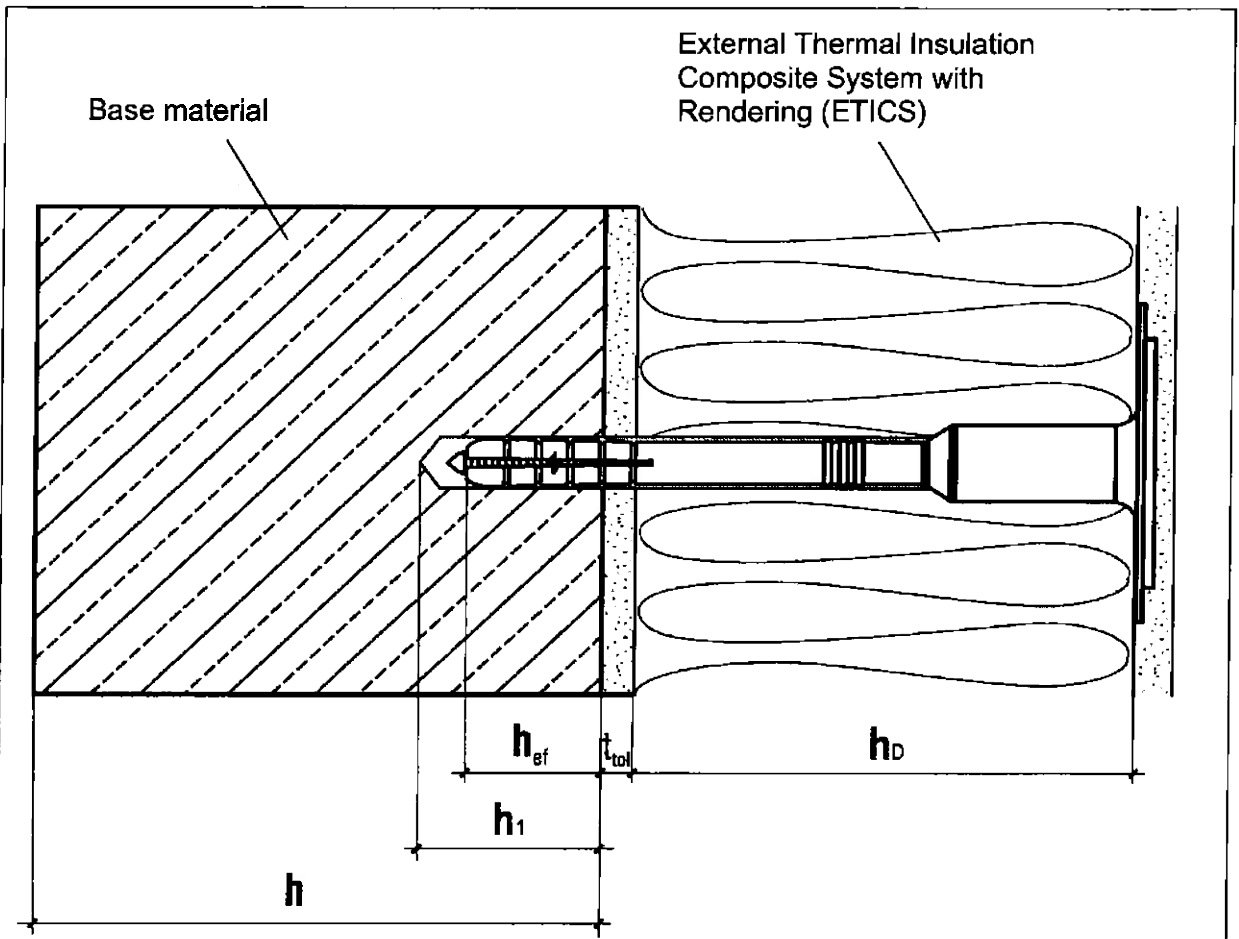


Legend

- h_{ef} = effective anchorage depth
- h_1 = depth of drill hole in base material
- h = thickness of base material
- h_D = thickness of insulation material
- t_{tol} = thickness of equalizing and/or non-load-bearing layer

WKThermϕ8	Annex A1 of European Technical Assessment ETA-11/0232
Product description Installation conditions	

WK THERM ϕ 8

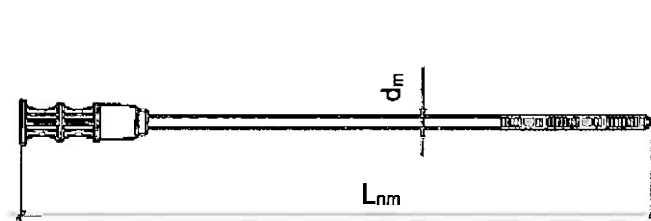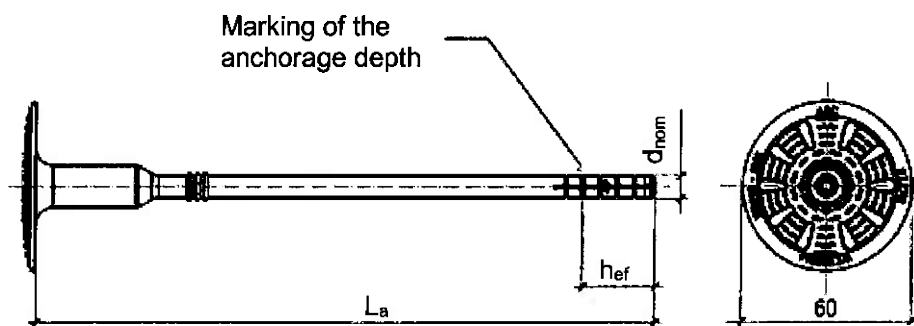

Marking:

Identifying mark:
(Wkręć-Met)

Sleeve type:
(WK THERM)

Length of anchor:
(e.g. 215)

Nominal diameter:
 d_{nom} (ϕ 8)

Table A2: WK THERM ϕ 8 anchor types and dimensions [mm]

Anchor type	Anchor sleeve			Expansion pin	
	d_{nom}	L_a	h_{ef}	d_m	L_{nm}
WK THERM ϕ 8 x 95	8	95	25	4,35	105
WK THERM ϕ 8 x 115	8	115	25	4,35	125
WK THERM ϕ 8 x 135	8	135	25	4,35	145
WK THERM ϕ 8 x 155	8	155	25	4,35	165
WK THERM ϕ 8 x 175	8	175	25	4,35	185
WK THERM ϕ 8 x 195	8	195	25	4,35	205
WK THERM ϕ 8 x 215	8	215	25	4,35	225
WK THERM ϕ 8 x 235	8	235	25	4,35	245
WK THERM ϕ 8 x 255	8	255	25	4,35	265
WK THERM ϕ 8 x 275	8	275	25	4,35	285
WK THERM ϕ 8 x 295	8	295	25	4,35	305
WK THERM ϕ 8 x 315	8	315	25	4,35	325
WK THERM ϕ 8 x 335	8	335	25	4,35	345
WK THERM ϕ 8 x 355	8	355	25	4,35	365

Determination of maximum thickness of insulation material: $h_D = L_a - t_{tol} - h_{ef}$

WK THERM ϕ 8

Product description

Marking and dimensions of the anchor sleeve and expansion element of the WK THERM ϕ 8

Annex A2

of European
Technical Assessment
ETA-11/0232

Table A3: Materials

Designation	Material
Anchor sleeve	Polyethylene, natural or grey
Expansion pin	Carbon steel ($f_{y,k} = 235$ MPa, $f_{u,k} = 360$ MPa) galvanised ≥ 5 μm according to EN ISO 4042, with head covered by polyamide PA6 (natural or grey)

WK THERM ϕ 8

Product description
Materials

Annex A3
of European
Technical Assessment
ETA-11/0232

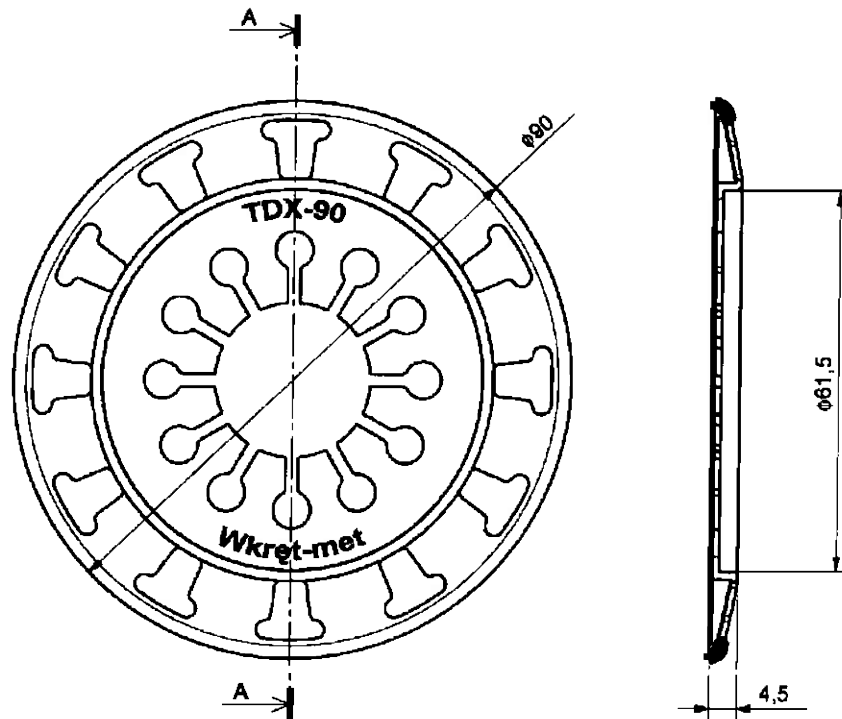


Table A4: Additional plate TDX-90 and TDX-P-90

Plate type	Outer diameter [mm]	Material
TDX-90	90	Polyamide+GF, natural or grey
TDX-P-90	90	Polyethylene, natural or grey

WKThermø8

Product description
Additional plate TDX-90 and TDX-P-90

Annex A4
of European
Technical Assessment
ETA-11/0232

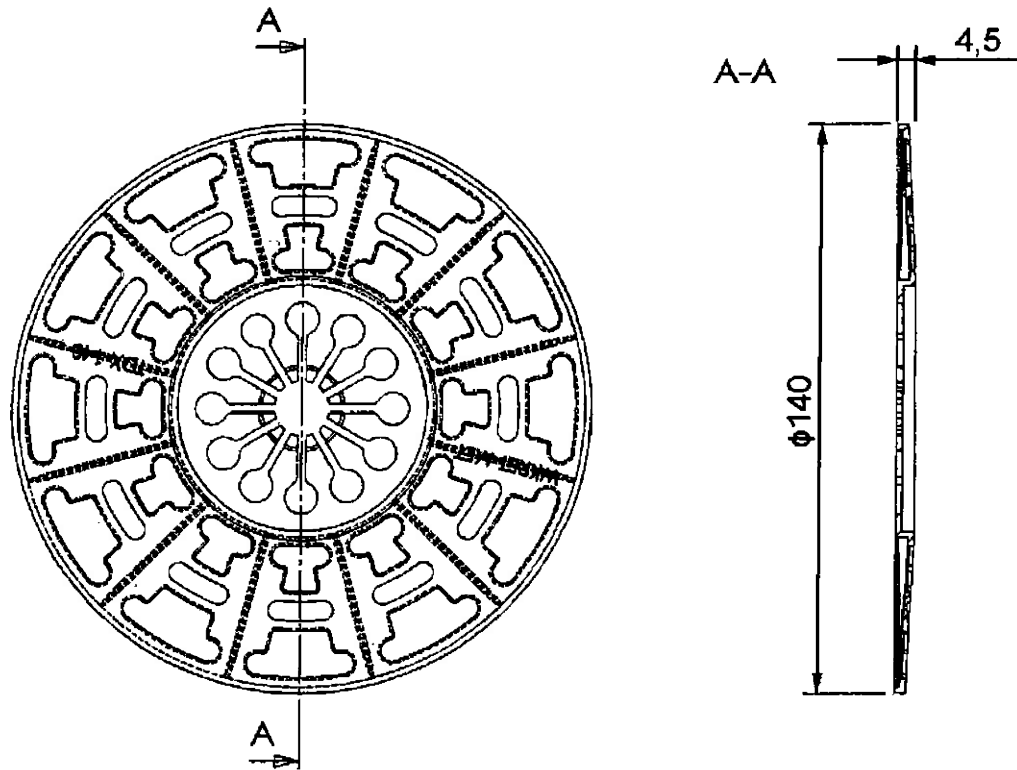


Table A5: Additional plate TDX-140 and TDX-P-140

Plate type	Outer diameter [mm]	Material
TDX-140	140	Polyamide+GF, natural or grey
TDX-P-140	140	Polyethylene, natural or grey

WK THERM ϕ 8

Product description
Additional plate TDX-140 and TDX-P-140

Annex A5
of European
Technical Assessment
ETA-11/0232

Specification of intended use

Anchorage subject to:

- Wind suction loads.

Note: Dead loads have to be transmitted by the adhesion of the relevant external thermal insulation composite system (ETICS).

Base materials:

- Normal weight concrete (use category A), according to Annex C1.
- Solid masonry (use category B), according to Annex C1.
- Hollow or perforated masonry (use category C), according to Annex C1.
- For other base materials of the use categories A, B or C the characteristic resistance of the anchor may be determined by job site tests according to ETAG 014, edition February 2011, Annex D.

Temperature range:

- 0°C to +40°C (max. short term temperature +40°C and max. long term temperature +24°C).

Design:

- The anchorages are designed in accordance with the ETAG 014, edition February 2011, under the responsibility of an engineer experienced in anchorages and masonry work.
- Verifiable calculation notes and drawings are prepared taking into account of the loads to be anchored. The position of the anchor is indicated on the design drawings.
- Fasteners are only to be used for multiple fixings for non-structural application, according to ETAG 014, edition February 2011.

Installation:

- Hole shall be drilled by the drill methods according to Annex C1.
- Anchor installation shall be carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Installation shall be executed in temperature from 0°C to +40°C.
- Exposure to UV due to solar radiation of the anchor not protected by rendering by the mortar shall not exceed 6 weeks.

WK THERM ϕ8	Annex B1 of European Technical Assessment ETA-11/0232
Intended use Specifications	


Table B1: Installation parameters

Anchor type		WK THERM ϕ 8
Nominal diameter of drill bit	d_o [mm]	8
Cutting diameter of drill bit	d_{cut} [mm]	$\leq 8,45$
Depth of drill hole	h_1 [mm]	≥ 35
Effective anchorage depth	h_{ef} [mm]	≥ 25

Table B2: Minimum thickness of base material, spacing and edge distance

Anchor type		WK THERM ϕ 8
Minimum thickness of base material	h [mm]	100
Minimum spacing	s_{min} [mm]	100
Minimum edge distance	c_{min} [mm]	100

Diagram of spacing

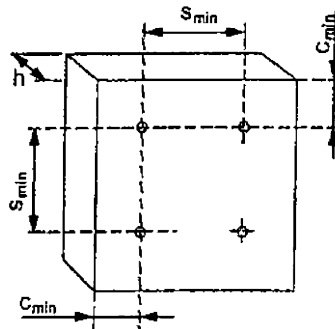


WK THERM ϕ 8


Intended use
Installation characteristics, minimum thickness of base material, spacing and edge distance

Annex B2
of European
Technical Assessment
ETA-11/0232


Installation instruction

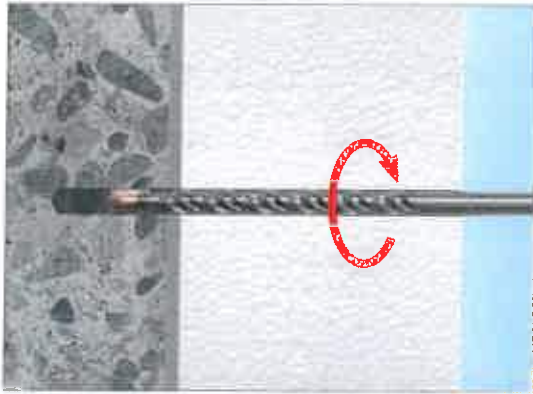


1. Drill hole by corresponding drilling method

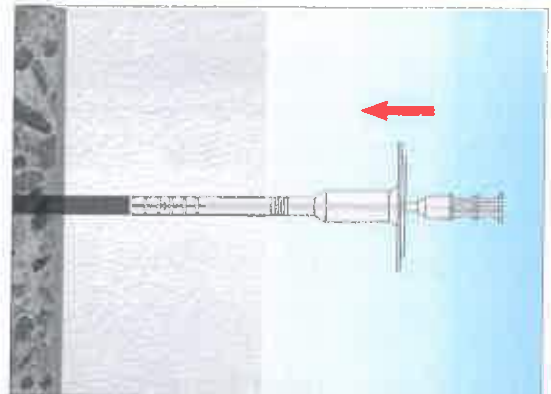

2. Set-in anchor manually

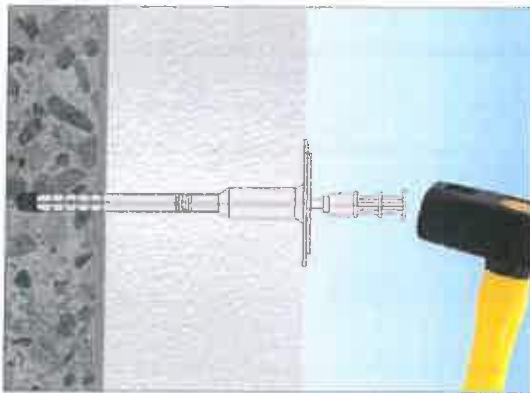

3. Set anchor by hammer blows

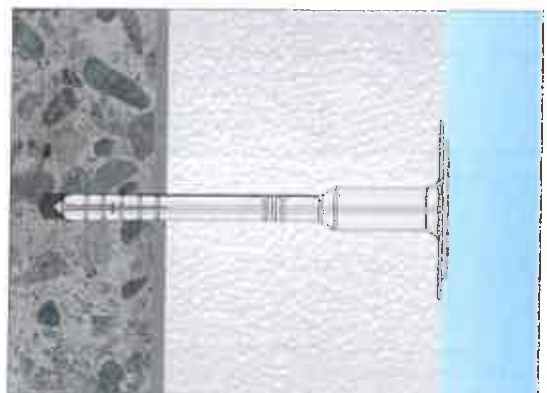







4. Correctly installed anchor

WK THERM ϕ 8

Intended use
Installation instruction

Annex B3
of European
Technical Assessment
ETA-11/0232

Table C1.1: Characteristic resistance to tension loads N_{Rk} , kN, for single anchor

Use category	Base material	Bulk density [kg/dm ³]	Compressive strength [N/mm ²]	Referring standard	N_{Rk} [kN]	Drill method
					WKTherm ϕ 8	
A	Concrete C12/15	–	–	EN 206-1	1,2	hammer
	Concrete C16/20 + C50/60	–	–	EN 206-1	1,5	hammer
B	Clay bricks ¹⁾ 	$\geq 1,70$	$\geq 30,0$	EN 771-1	1,5	hammer
	Calcium silicate bricks ²⁾ 	$\geq 2,00$	$\geq 20,0$	EN 771-2	1,5	hammer
C	Calcium silicate hollow blocks ³⁾  $a^{5)} = 30 \text{ mm}$ 	$\geq 1,60$	$\geq 12,0$	EN 771-2	1,2	hammer
	Perforated clay bricks ⁴⁾  $a^{5)} = 13 \text{ mm}$ 	$\geq 0,95$	$\geq 12,0$	EN 771-1	0,6	rotary

¹⁾ German clay brick MZ Rd 2,0/20

²⁾ For example Kalksandstein KS NF 20-2,0 Vollstein according to DIN 108

³⁾ For example KSL-R(P)8DF Lochstein according to DIN 106







⁴⁾ For example Hz B – 1.0 1NF 12-1 according to DIN 105

WKTherm ϕ 8

Performances
Characteristic resistance

Annex C1
of European
Technical Assessment
ETA-11/0232

Table C1.2: Characteristic resistance to tension loads N_{Rk} , kN, for single anchor

Use category	Base material	Bulk density [kg/dm ³]	Compressive strength [N/mm ²]	Referring standard	N_{Rk} [kN]	
					WKTherm ϕ 8	Drill method
C	Perforated clay bricks ⁶⁾  $a^{5)} = 13 \text{ mm}$ 	$\geq 0,95$	$\geq 12,0$	EN 771-1	0,6	rotary
	Vertically perforated porous block ⁷⁾  $a^{5)} = 10 \text{ mm}$ 	$\geq 0,80$	$\geq 15,0$	EN 771-1	0,6	rotary
	Vertically perforated clay bricks ⁸⁾  $a^{5)} = 12 \text{ mm}$ 	$\geq 0,80$	$\geq 15,0$	EN 771-1	0,6	rotary
Partial safety factor for anchor resistance, $\gamma_M^{9)}$		2,0				
⁵⁾ Minimum values "a". For elements with lower value of "a" the load tests on the construction are required ⁶⁾ For example Hz B – 1.0 3NF 12-1 according to DIN 105 ⁷⁾ For example Porotherm 25 P+W ⁸⁾ For example MEGA-MAX 250 ⁹⁾ Valid in absence of national regulations						

WKThermϕ8	Annex C1 of European Technical Assessment ETA-11/0232
Performances Characteristic resistance	

Table C2: Point thermal transmittance according to EOTA Technical Report TR 025


Anchor type	Insulation thickness h_D [mm]	Point thermal transmittance χ [W/K]
WK THERM ϕ 8	60 – 320	0,002

Table C3: Plate stiffness according to EOTA Technical Report TR 026

Anchor type	Diameter of the anchor plate d_{plate} [mm]	Load resistance of the anchor plate $N_{u,m}$ [kN]	Plate stiffness $N_{0,m}$ [kN/mm]
WK THERM ϕ 8	60	4,3	0,6

WK THERMϕ8	Annex C2 of European Technical Assessment ETA-11/0232
Performances Point thermal transmittance and plate stiffness	







Table C4.1: Displacements

Use category	Base material	Bulk density [kg/dm ³]	Compressive strength [N/mm ²]	Tension load N [kN]	Displacements $\delta_m(N)$ [mm]
				WKTherm ϕ 8	WKTherm ϕ 8
A	Concrete C12/15	–	–	0,4	0,80
	Concrete C16/20 ÷ C50/60	–	–	0,5	0,85
B	Clay bricks ¹⁾ 	≥ 1,70	≥ 30,0	0,4	1,00
	Calcium silicate bricks ²⁾ 	≥ 2,00	≥ 20,0	0,5	0,98
C	Calcium silicate hollow blocks ³⁾  a ⁵⁾ = 30 mm 	≥ 1,60	≥ 12,0	0,4	0,90
	Perforated clay bricks ⁴⁾  a ⁵⁾ = 13 mm 	≥ 0,95	≥ 12,0	0,2	0,61

¹⁾ German clay brick MZ Rd 2,0/20
²⁾ For example Kalksandstein KS NF 20-2,0 Vollstein according to DIN 108
³⁾ For example KSL-R(P)8DF Lochstein according to DIN 106
⁴⁾ For example Hlz B – 1.0 1NF 12-1 according to DIN 105

WKThermϕ8	Annex C3 of European Technical Assessment ETA-11/0232
Performances Displacements	

Table C4.2: Displacements

Use category	Base material	Bulk density [kg/dm ³]	Compressive strength [N/mm ²]	Tension load N [kN]	Displacements δ _m (N) [mm]
				WKThermφ8	WKThermφ8
C	Perforated clay bricks ⁶⁾  a ⁵⁾ = 13 mm 	≥ 0,95	≥ 12,0	0,2	0,62
	Vertically perforated porous block ⁷⁾  a ⁵⁾ = 10 mm 	≥ 0,80	≥ 15,0	0,2	0,46
	Vertically perforated clay bricks ⁸⁾  a ⁵⁾ = 12 mm 	≥ 0,80	≥ 15,0	0,2	0,61
⁵⁾ Minimum values "a". For elements with lower value of "a" the load tests on the construction are required ⁶⁾ For example Hz B – 1.0 3NF 12-1 according to DIN 105 ⁷⁾ For example Porotherm 25 P+W ⁸⁾ For example MEGA-MAX 250					

WKThermφ8	Annex C3 of European Technical Assessment ETA-11/0232
Performances Displacements	

